


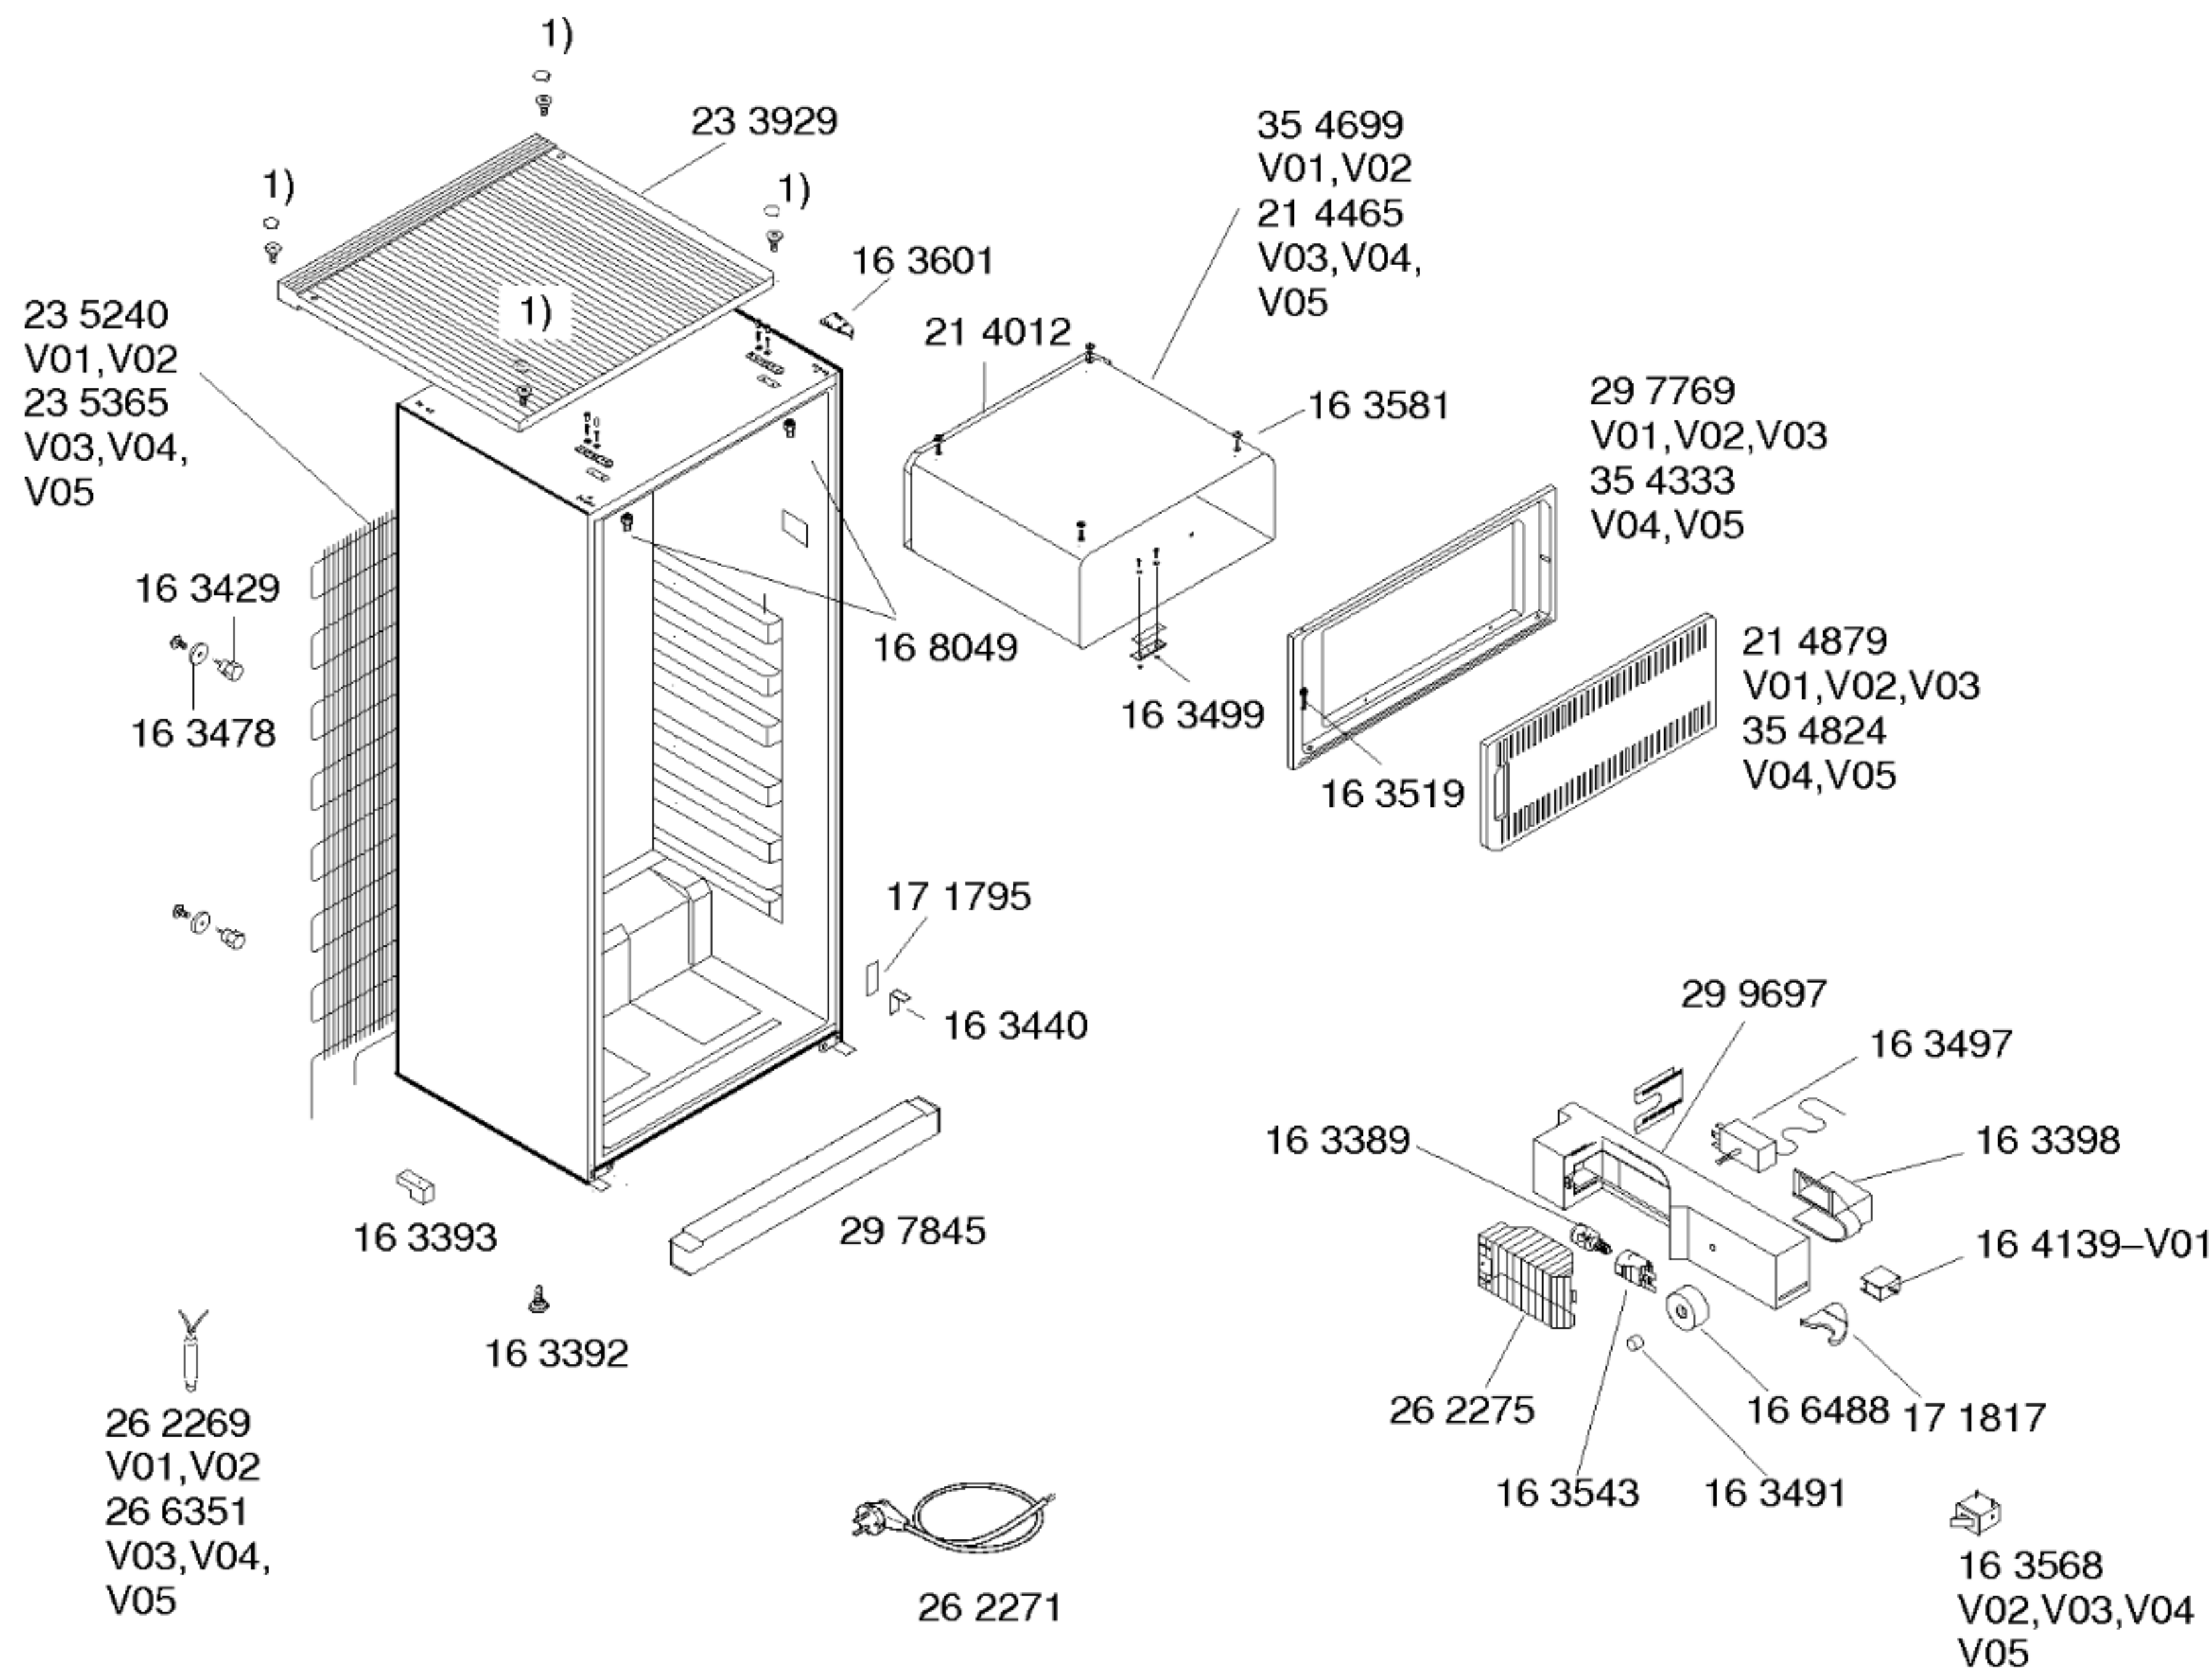
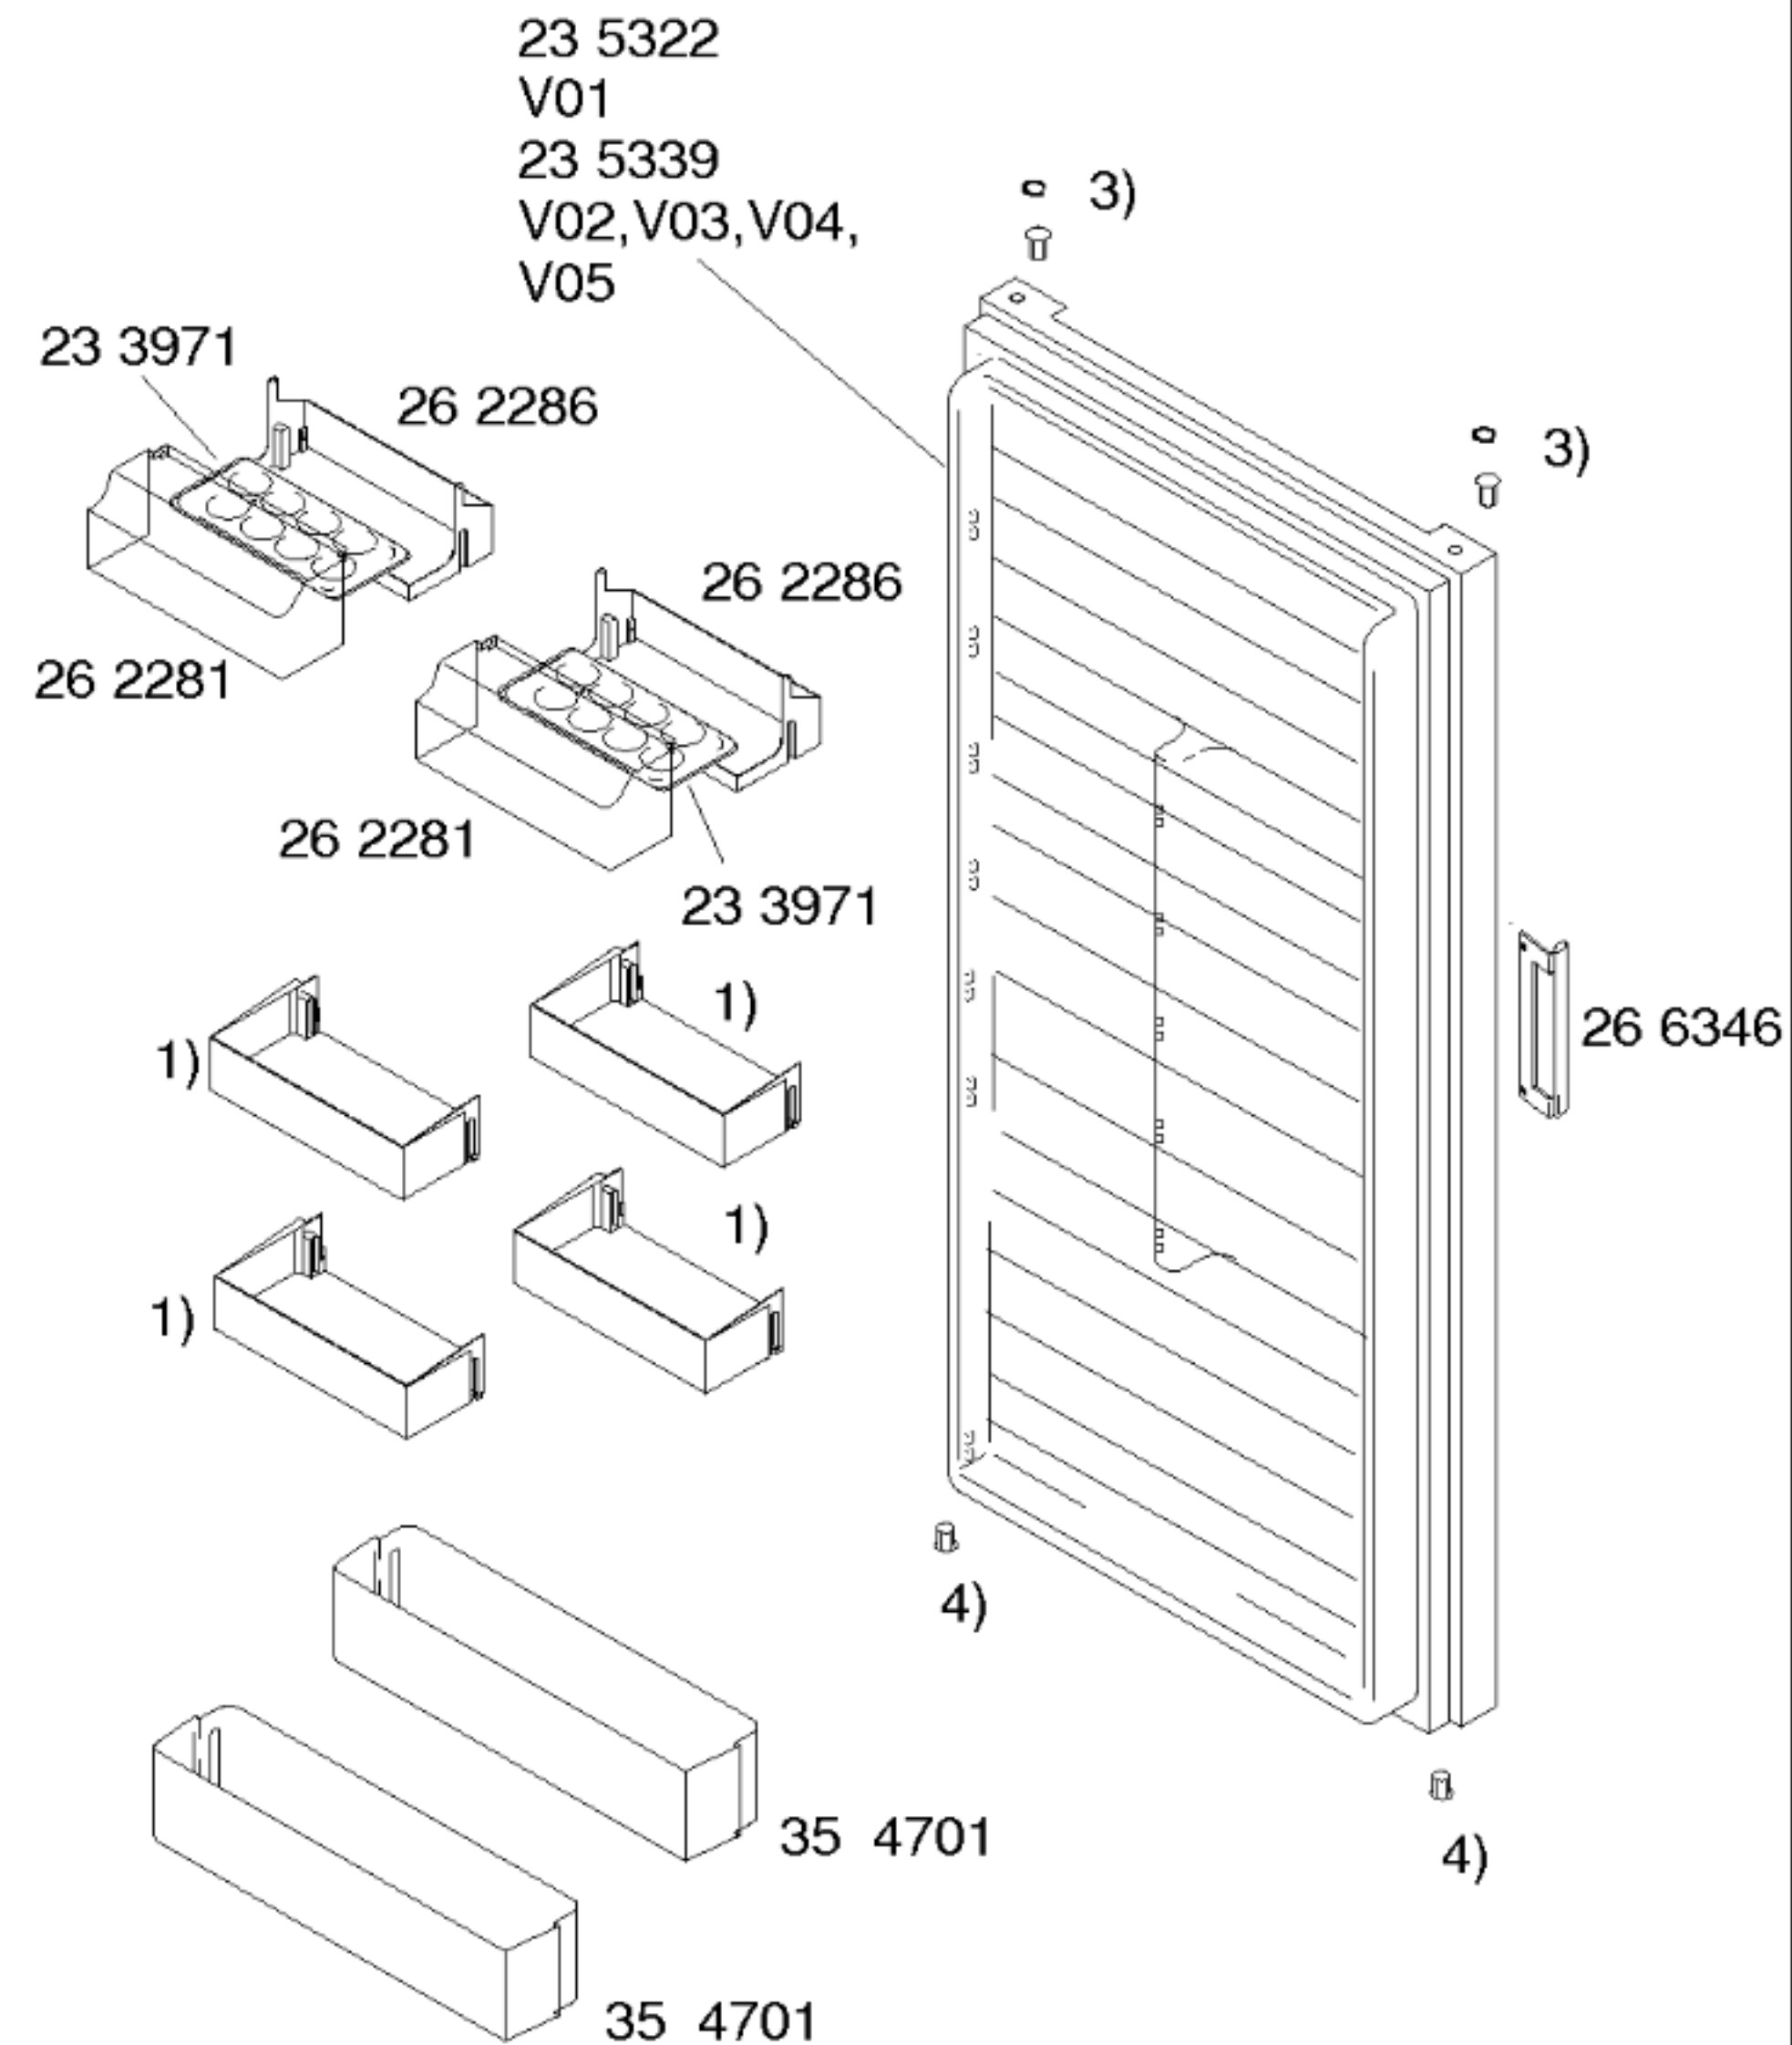
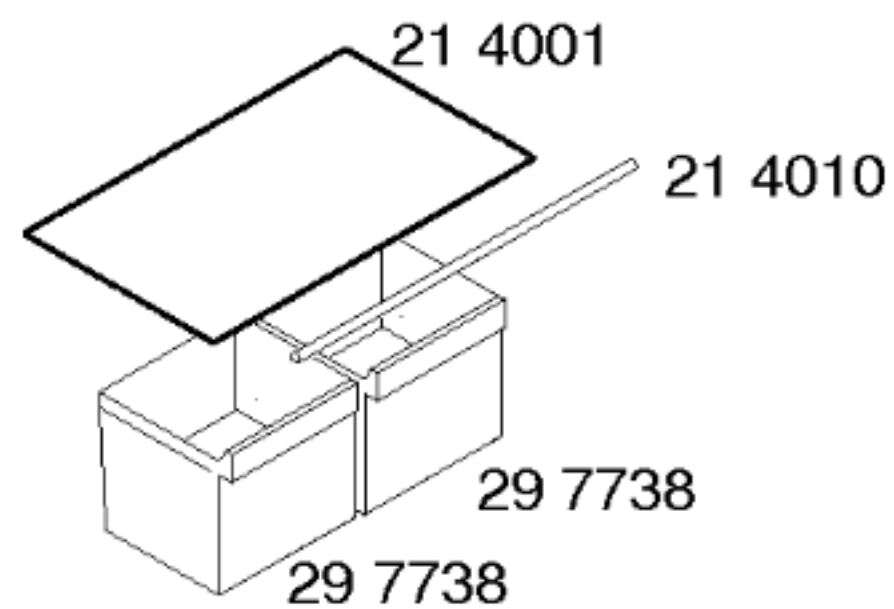


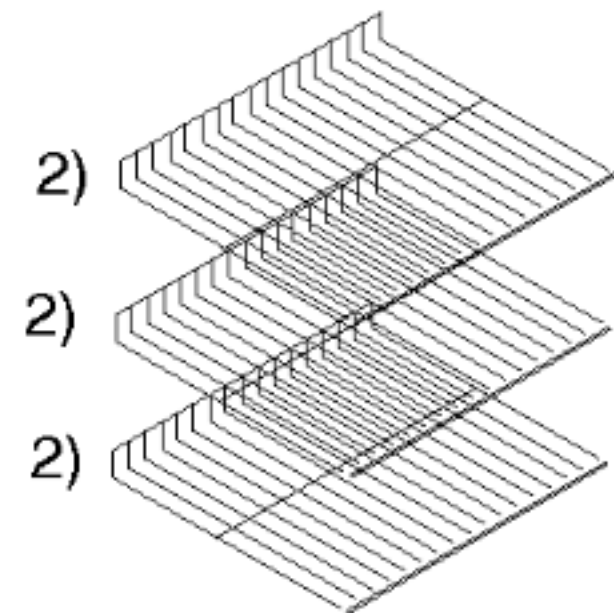

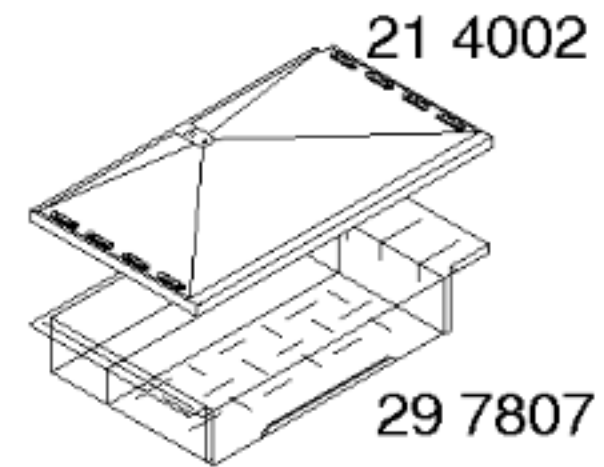

- 1) 35 4700
- 2) 21 4008
- 3) 16 3509
- 4) 16 8762

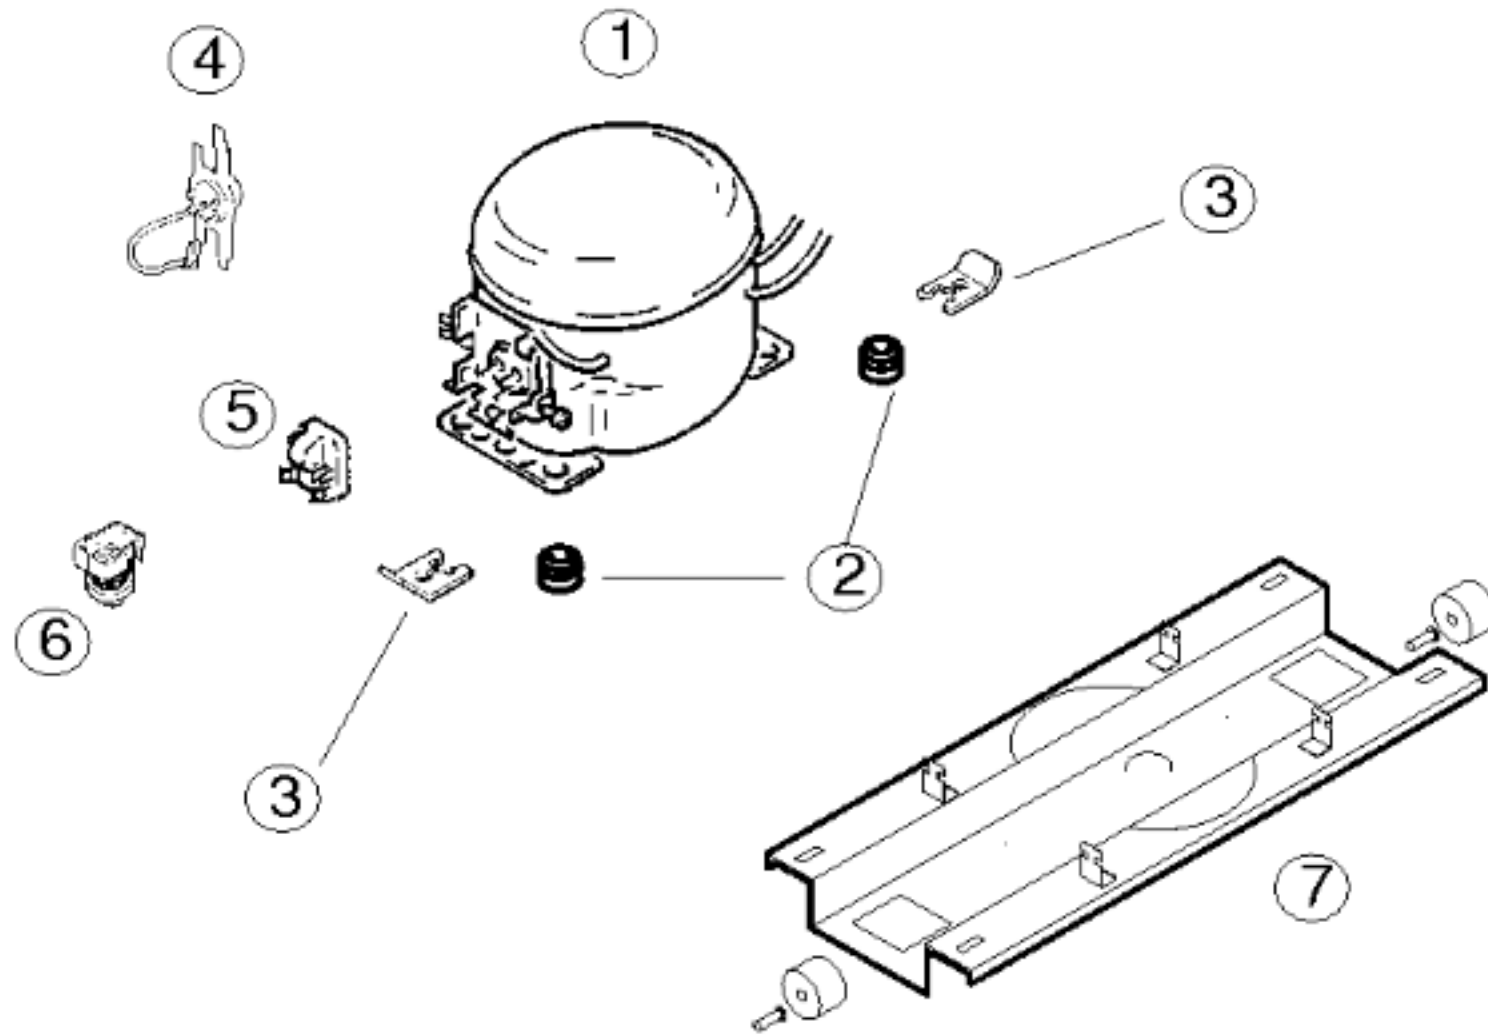

	V01	V02,V03,V04	V05
Pos.	LK55.6	Danfoss NL 7FT	
1	14 1609	14 1810	14 1937
2	16 3427		
3	16 3508		
4	16 3488		
5		16 5570	
6	16 3452		
7	29 7801		
8			
9			
10			
11			
12			

TECHNISCHE DATEN/TECHNICAL DATA/TEKNIK BILGILER			
	V01	V02,V03	
Verdichter/Compressor/Kompresör Typ/Type/TipT Förderleistung/Delivery/Verim/h Anlaufstrom/Starting current/Giris akimi A Widerstand/Resistance/Rezistans Ha/Ω Hi/aux.	LK55.6	Danfoss NL7FT 11,4 10,7 13	
Temp.Reyler/Thermostat/Termostat Typ/Type/Tip Reglerstellung/Position/Termostat pozisyonu Schaltwerte/Acma kapama degerleri ..ein/acma °C Valeurs de commutation/Termostat degeri ..aus"/kapama (..abtaven' od) ..alarm'		HANCO K50	
Füllmenge/Fill. quantity/ Dolum miktari R134 a g	*		
Anschlusswert/Comm. load/Giris gucu W			
Heizung/Heater/Rezistans Widerstand/Resistance/Direnc Ω Leistung/Power/Guc W			
Ventilador/Blower/Vantilatör Widerstand/Resistance/Rezistans Ω			
Magnetventil/Magnetic valve/Manyetik valf Widerstand/Resistance/Rezistans Ω Spannung/Voltage/Gerilim V			
Temp.Reyler/Thermostat/Termostat			

* Siehe Typenschild/Mamul etiketine bakiniz